

# 15 IEC 61850

- 15.1 Introduction
- 15.2 IEC 61850 Server
- 15.3 IEC 61850 Client

# 15.1 Introduction

IEC 61850 is an international standard defining communication protocols for intelligent electronic devices at electrical substations. It is a part of the International Electrotechnical Commission's (IEC) Technical Committee 57 reference architecture for electric power systems. The abstract data models defined in IEC 61850 can be mapped to several protocols. Possible mappings in the standard can be MMS (Manufacturing Message Specification), GOOSE (Generic Object Oriented Substation Event), and SMV (Sampled Measured Values). These protocols can run over TCP/IP networks or substation LANs using high-speed switched Ethernet to obtain the necessary response times below four milliseconds for protective relaying.



As of version v1.5.0, WCC Lite supports MMS-type messaging. Logging and group setting services are not supported.

# 15.2 IEC 61850 Server

WCC Lite can act as an IEC 61850 server to serve data to remote SCADA systems. For example, WCC Lite can be used to acquire data from various protocols (Modbus, IEC 60870-5-103, etc.), this data can be redirected and propagated further to a single or multiple IEC 61850 clients. IEC 61850 Server supports TCP and TLS connection types. TCP connection can be secured with password authentication.

## Commands


WCC Lite **IEC 61850 Server** implementation defines four command types which are described by their control model:

- **Case 1:** Direct control with normal security (direct-operate);
- **Case 2:** SBO control with normal security (operate-once or operate-many);
- **Case 3:** Direct control with enhanced security (direct-operate);
- **Case 4:** SBO control with enhanced security (operate-once or operate-many).

Normal security commands are considered for execution if the command signal is found in Excel configuration. There aren't any additional checks in command execution in any master protocol.

Enhanced security commands need feedback from the master protocol to either succeed or fail. If feedback is not received within the **command\_ack\_timeout\_ms** timeframe, the command is considered failed.

Command value attributes (e.g. stVal) must be updated separately (if they need to be updated).

 When using SBO commands, select is not routed to the master protocol and select logic is performed only in IEC 61850 Server protocol.

## Configuring data points

To use the IEC 61850 Server in WCC Lite, it has to be configured via an Excel configuration and the data model must be uploaded. This configuration contains two Excel sheets where parameters have to be filled in - Devices and Signals.

If a few devices were to connect to a server using the same virtual port, all of the IP addresses have to be specified on the host field separated by space. That way all of the clients will be able to connect from different IP addresses but using the same port as long as they all have the same subnet address.

### IEC 61850 Server parameters for Devices tab

Parameter	Type	Description	Required	Default value (when not specified)	Range	
					Min	Max
name	string	User-friendly name for a device	Yes			
description	string	Description of a device	No			
device_alias	string	Alphanumeric string to identify a device	Yes			
enable	boolean	Enabling/disabling of a device	No	1	0	1
protocol	string	Protocol to be used	Yes		IEC 61850 Server	
bind_address	string (IP address format)	The IP address of an interface to use with the server	No	0.0.0.0		
host	string (IP address format)	IP address list of allowed IPs (separated with spaces)	Yes			
port	integer	TCP communication port	No	102		

auth	string	Authorization type	Yes		"NONE", "PASSWORD", "TLS"	
password	string	Authorization password for server device	Yes ( for PASSWORD)			
tls_local_certificate	string	Local certificate for TLS connection	Yes (for TLS)			
tls_peer_certificate	string	Certificate authority file for TLS connection	Yes (for TLS)			
tls_private_key	string	A file consisting of the private key for TLS connection	Yes (for TLS)			
ied_name	string	Name of an Intelligent Electronic Device	Yes			
originator	string	Origin identification for the device	No			
model_filename	string	The filename of the server model, without the .server extension	Yes			
command_ack_timeout_ms	integer	Timeframe (ms) in which enhanced security commands must be acknowledged (Default: 3000)	No	3000		
report_buffered_size	integer	Report control blocks buffer size in bytes (Default: 65536)	No	65536		
report_unbuffered_size	integer	Unbuffered report control blocks buffer size in bytes (Default: 65513)	No	65513		

## IEC 61850 Server parameters for Signals tab

Parameter	Type	Description	Required	Default value (when not specified)	Range	
					Min	Max
signal_name	string	User-friendly signal name	Yes			
device_alias	string	Device alias from a Devices tab	Yes			
signal_alias	string	Unique alphanumeric name of the signal to be used	Yes			
enable	boolean	Enabling/disabling of an individual signal	No	1	0	1
log	boolean	Allow signal to be logged. If the <b>log is 0</b> signal will not be logged. If the <b>log is more than 0</b> signal will be logged	No	0		


number_type	string	Number format type (BOOLEAN, FLOAT, INT16, etc.)	Yes		BOOLEAN, INT8, INT16, INT32, INT64, INT128, INT8U, INT24U, INT32U, FLOAT32, FLOAT64, ENUMERATED, OCTET STRING 64, OCTET STRING 6, OCTET STRING 8, VISIBLE STRING 32, VISIBLE STRING 64, VISIBLE STRING 65, VISIBLE STRING 129, VISIBLE STRING 255, UNICODE STRING 255, TIMESTAMP, QUALITY, CHECK, CODEDENUM, GENERIC BITSTRING, CONSTRUCTED, ENTRY TIME, PHYCOMADDR, CURRENCY, OPTFLDS, TRGOPS
ld_instance	string	An instance of a logical device	Yes		
ln_class	string	Logical node class type	Yes		
ln_instance	integer	An instance of a logical node	No		
ln_prefix	string	Prefix of logical node string	No		
cdc	string	Common Data Class (CDC) name	Yes		SPS, DPS, INS, ACT, ACD, SEC, MV, CMV, WYE, DEL, SEQ, SPG, ING, ASG, ENS, ENG
data_object	string	Name of a data object in the dataset	Yes		
da_value	string	Name of a data attribute value node	Yes		
da_fc	string	Functional constrain for data object	Yes		ST, MX, CO, SP
control_model	string	Model of output control	Yes (for commands)	read-only	read-only, direct-with-normal-security, sbo-with-normal-security, direct-with-enhanced-security, sbo-with-enhanced-security

## Device status signals

IEC 61850 has an additional signal which can be configured to show communication status. It is used to indicate if the client device has disconnected from the server (WCC Lite). To configure such a signal for the IEC 61850 protocol, **job\_todo** field with string value is required. For the IEC 61850 server required parameters for the status signal will be: **signal\_name**, **device\_alias**, **signal\_alias**, and **job\_todo**. Job\_todo must be: **communication\_status**. If the signal returns the value of 1 – the device or protocol connection is on and working properly, if 2 – the device is off or the protocol is disconnected.

## Converting and uploading data model

To use the IEC61850 Server protocol in WCC Lite, the user must upload a data model in a specific format (file extension .server). These data models can be converted from SCL files (.icd, .cid or .scd files). To convert a data model, the user must use WCC Excel Utility. There's a separate tab for this operation as shown in the picture below.

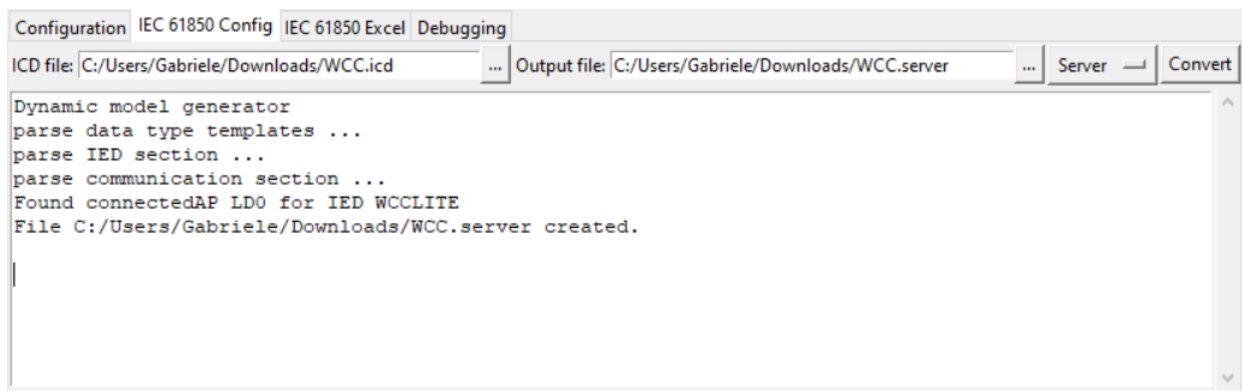

The converted file can be uploaded in the WCC Lite web interface, Protocol Hub section. The current model can be also downloaded on the same page as shown in the picture below.

<b>PROTOCOL HUB</b>	STATUS	SYSTEM	SERVICES	NETWORK	USERS	LOGOUT (ROOT)
<b>CONFIGURATION</b>	IMPORTED SIGNALS	EVENT LOG	PROTOCOL CONNECTIONS	SCRIPT-RUNNER		

### Protocol configuration

#### IMPORT PROTOCOL CONFIGURATION

Here you can import Excel configuration file. Up to 1000 signals are allowed. All previous signals will be replaced.

Configuration file:  No file chosen

PLC (IEC-61499) Boot file:  No file chosen

IEC61850 Client model file:  No file chosen

IEC61850 Server model file:  No file chosen

#### DOWNLOAD CONFIGURATION


Current configuration (WCC.xlsx):

Template configurations:

Current IEC 61850 Server model file (WCC.server):

## Debugging an IEC 61850 server application

If the configuration for the IEC 61850 Server is set up, a handler for the protocol will start automatically. If the configuration is missing or contains errors, the protocol will not start. It is done intentionally to decrease unnecessary memory usage.

 If the IEC 61850 Server does not work properly (e.g. no communication between devices, data is corrupted, etc.), a user can launch a debug session from the command line interface and find out why the link is not functioning properly.

 To launch a debugging session, a user should stop `iec61850-server` process and run `iec61850-server` command with respective flags as you can see below:

Step 1: Service must be stopped by entering the following command into the wcc-lite:  
`/etc/init.d/iec61850-server stop`

Step 2: After the service is stopped it must be started with the preferred configuration file (JSON files found in the `/etc/` folder) and a debug level 7:

`iec61850-server -c /etc/iec61850-server/iec61850-server.json -d7`

Additional output forming options described in the table below.

Step 3: Once the problem is diagnosed normal operations can be resumed with the following command:

`/etc/init.d/iec61850-server start`

`-h [--help]` Show help message

```
-c [--config] arg Configuration file location
-V [--version] Show version
-d [--debug] arg Set Debug level
-r [--redis] Show Redis messages
```

# 15.3 IEC 61850 Client

WCC Lite can be used as a master station to collect data from IEC 61850-compatible server devices such as protection relays. As relays require fast, secure and responsive interfaces, WCC Lite can be considered as a valid option. For additional security, a user can use encrypted transmission (TLS) or set up a password.

As TCP (TLS) connections can encounter issues and break, automatic reconnection is implemented. After every failed reconnection attempt, the fallback delay is double, starting from 1 second up until 32 seconds. After the,at connection reestablishment will be attempted every 32 seconds until a successful connection.

## Acquiring data via report control blocks

As per the IEC 61850 standard, the report control block controls the procedures that are required for reporting values of data objects from one or more logical nodes to one client. Automatic reporting enables data servers (slave devices) to only send data on their (or their quality) change, thus saving network bandwidth. Instances of report control blocks are configured in the server at configuration time.

Report control blocks send information that is defined in their respective datasets. The dataset is a set of data elements grouped to represent a data group. For example, it is a common practice to group measurements and events into different groups.

A server restricts access to an instance of a report control block to one client at a time. That client exclusively shall own that instance and shall receive reports from that instance of report control blocks. There are two classes of report control blocks defined, each with a slightly different behaviour:

- Buffered-report-control-block (BRCB) - internal events (caused by trigger options data-change, quality-change, and data-update) issue immediate sending of reports or buffer the events (to some practical limit) for transmission, such that values of the data object are not lost due to transport flow control constraints or loss of connection. BRCB provides the sequence-of-events (SOE) functionality;
- unbuffered-report-control-block (URCB) - internal events (caused by trigger options data-change, quality-change, and data-update) issue immediate sending of reports on a best efforts basis. If no association exists, or if the transport data flow is not fast enough to support it, events may be lost.

Buffered report control blocks are therefore useful to keep event data, for example, keeping the last known state of a relay switch, where a loss of information might lead to confusion and even financial losses. Unbuffered report control blocks are particularly useful for data which is useful only momentarily, e.g. measurements of voltages, current or power. This information can change frequently, and old measurements might not reflect the real state of a substation.

To allow multiple clients to receive the same values of data objects, multiple instances of the report control classes shall be made available.

Buffered report control blocks are usually configured to be used by a specific client implementing a well-defined functionality, for example, a SCADA master. The client may know the ObjectReference of the BRCB by configuration or by the use of a naming convention.

Parsing of report control blocks is based on types of Common Data Classes (CDC). Some of these types can have more than one data point of interest. The table below shows what data attributes are supported by various Common Data Classes. To select which data attribute should be used, a `da_value` column should be filled with a data attribute name. Common Data Classes consist of data attributes with different Functional Constraints; therefore, to get the status points of interest correctly, the user must fill in the correct value in `da_fc` the column.

IEC 61850 Client-supported data attributes:

Common Data Class	Function Constraint	Data attributes
SPS DPS INS ENS	ST	stVal
ACT	ST	general phsA phsB phsC neut
ACD	ST	general dirGeneral phsA dirPhsA phsB dirPhsB phsC dirPhsC neut dirNeut



MV	MX	instMag mag
CMV	MX	instCVal cVal
SAV	MX	instMag
SPC DPC INC ENC	ST	stVal
BSC ISC	ST	valWTr
APC BAC	MX	mxVal

Some of the data attributes are structures themselves, for example, the `mag` attribute is a struct that can hold integer or float values. To select a fitting attribute, the user should extend `da_value` parameter with additional attributes, for example, if a float magnitude value is to be selected from the MV Common Data Class, the `da_value` column should be filled with `mag.f` value; if the user intends `cVal` magnitude value in float format from the CMV Common Data Class, `da_value` should be filled with `cVal.mag.f` value. See IEC 61850-7-3 for more information about Common Data Classes.

To ensure the integrity of the configuration, WCC Lite has additional checks implemented at configuration time. If the report control block (or its dataset) with a predefined ObjectReference doesn't exist, it is considered that the IEC 61850 Client has not been configured properly, or the configuration has been changed in either of the IEC 61850 devices and cannot be matched, therefore should be considered invalid.

## Controlling remote equipment via commands

The control model provides a specific way to change the state of internal and external processes by a client. The control model can only be applied to data object instances of a controllable Common Data Class (CDC) whose `ctlModel` DataAttribute is not set to status-only. Such data objects can be referred to as control objects. If controls are enabled in an IEC 61850 Server device, the user can configure controls by filling the `control_model` column in the Excel configuration with a control model (*direct-with-normal-security*, *sbo-with-normal-security*, *direct-with-enhanced-security*, *sbo-with-enhanced-security*) as well as setting functional constraints in `da_fc` column to CO.

Depending on the application, different behaviours of a control object shall be used. Therefore, different state machines are defined. Four cases are defined:

- **Case 1:** Direct control with normal security (direct-operate);
- **Case 2:** SBO control with normal security (operate-once or operate-many);
- **Case 3:** Direct control with enhanced security (direct-operate);
- **Case 4:** SBO control with enhanced security (operate-once or operate-many).

IEC 61850 standard enables the user to plan command transmission - set the timer when the command should be issued. However, as this possibility is rarely used in practice, it is not implemented as of version v1.8. All issued commands are executed immediately.

For more information on the control class model, please consult the IEC 61850-7-2 standard.

If `ctlModel` is read-only, messages from the internal database will be ignored for this point, otherwise, a subscribe callback will be launched to handle commands as soon as they are sent. If the CDC of a signal does not have a means of control, the `ctlModel` parameter is ignored.

Originator identification can be attached to a station so that replies to command requests can be forwarded to only one device. To use this functionality, a user should select an origin identifier by filling value in the Excel configuration, originator column. The originator category is always enforced to indicate that a remote control command is issued.

## Configuring datapoints

To use the IEC 61850 Client in WCC Lite, it has to be configured via an Excel configuration. This configuration contains two Excel sheets where parameters have to be filled in - the Devices and Signals tables.

Table IEC 61850 Client parameters for *Devices* tab

Parameter	Type	Description	Required	Default value (when not specified)	Range	
					Min	Max
name	string	User-friendly name for a device	Yes			

description	string	Description of a device	No			
device_alias	string	An alphanumeric string to identify a device	Yes			
enable	boolean	Enabling/disabling of a device	No	1	0	1
protocol	string	Protocol to be used	Yes		IEC 61850 Client	
host	string (IP address format)	The IP address of the server device	Yes			
port	integer	TCP communication port	No	102		
auth	string	Authorization type	Yes		None, password, tls	
password	string	Authorisation password for the server device	Yes (for PASSWORD)			
tls_local_certificate	string	Local certificate for TLS connection	Yes (for TLS)			
tls_peer_certificate	string	Certificate authority file for TLS connection	Yes (for TLS)			
tls_private_key	string	A file consisting of the private key for a TLS connection	Yes (for TLS)			
ied_name	string	Name of an Intelligent Electronic Device	Yes			
originator	string	Origin identifier for the device	No			
model_filename	string	The filename of the client model uploaded to WCC (must contain the .client extension)	Yes			

Table IEC 61850 Client parameters for *Signals* tab

Parameter	Type	Description	Required	Default value (when not specified)	Range	
					Min	Max
signal_name	string	User-friendly signal name	Yes			
device_alias	string	Device alias from the Devices tab	Yes			
signal_alias	string	Unique alphanumeric name of the signal to be used	Yes			
enable	boolean	Enabling/disabling of an individual signal	No	1	0	1
log	boolean	Allow the signal to be logged. If the <b>log is 0</b> signal will not be logged. If the <b>log is more than 0</b> signal will be logged	No	0		

number_type	string	Number format type	Yes		BOOLEAN, INT8, INT16, INT32, INT64, INT128, INT8U, INT24U, INT32U, FLOAT32, FLOAT64, ENUMERATED, OCTETSTRING6, OCTETSTRING8, OCTETSTRING64, VISIBLESTRING32, VISIBLESTRING64, VISIBLESTRING65, VISIBLESTRING129, VISIBLESTRING255, UNICODESTRING255, TIMESTAMP, QUALITY, CHECK, CODEDENUM, GENERICBITSTRING, CONSTRUCTED, ENTRYTIME, PHYCOMADDR, CURRENCY, OPTFLDS, TRGOPS	
Id_instance	string	An instance of a logical device	Yes			
In_class	string	Logical node class type	Yes			
In_instance	integer	An instance of a logical node	No			
In_prefix	string, integer	The prefix of the logical node string	No			
cdc	string	Common Data Class (CDC) name	Yes		SPS, DPS, INS, ACT, ACD, SEC, MV, CMV, WYE, DEL, SEQ, SPG, ING, ASG, ENS, ENG, SPC, DPC, INC, ENC, BSC, BAC, ISC, APC.	
data_object	string	Name of a data object in the dataset	Yes			
da_value	string	Name of a data attribute value node	Yes			
da_fc	string	Functional constrain for data objects	Yes		ST, MX, CO, SP, SE	
control_model	string	Model of output control	No	read-only	read-only, direct-with-normal-security, sbo-with-normal-security, direct-with-enhanced-security, sbo-with-enhanced-security	
dataset	string	Full object reference of a dataset	Yes			
report_control_block	string	Full object reference of a report control block	Yes			
intgPd	integer	Integrity period in milliseconds	No	0		



It should be noted that ACT and ACD messages can only be parsed from the report if either only the 'general' attribute or all attributes attached to all three phases and neutral can be found in the report.




Some command CDC types are only available from firmware version 1.11.1

## Device status signals

IEC 61850 has an additional signal which can be configured to show communication status. It is used to indicate if the server device has disconnected from the client (WCC Lite). To configure such a signal for the IEC 61850 protocol, the job\_todo field with a string value is required. For IEC 61850 client required parameters for the status signal will be: **signal\_name**, **device\_alias**, **signal\_alias**, and **job\_todo**. Tag\_job\_todo must be: **communication\_status**. If the signal returns the value of 1, the device or protocol connection is on and working properly; if 2, the device is off or the protocol is disconnected.

Configuration of the IEC61850 Client for WCC Lite is done via the WCC Utility. Elseta WCC Utility has two IEC 61850 selections - IEC 61850 Config and IEC 61850 Excel:


- **IEC 61850 Config** is used to create a configuration model file, which the IEC 61850 Client service will use to parse reports from the server.
- **IEC 61850 Excel** is used to generate Excel configuration files, which in turn will be used to generate configuration.json via excel-utility.

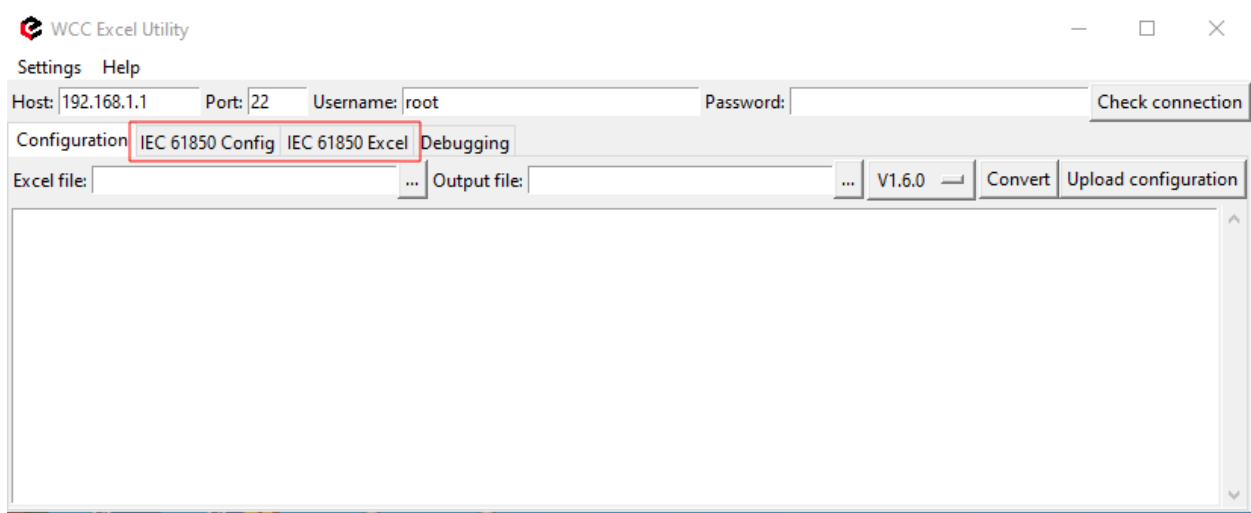

WCC Utility with IEC61850 selections

## Generate a model file


To generate the IEC 61850 Client model file, select "Client" in the drop-down selection tab. Then select where to output the generated model and upload a file with extensions .icd, .scd or .cid.

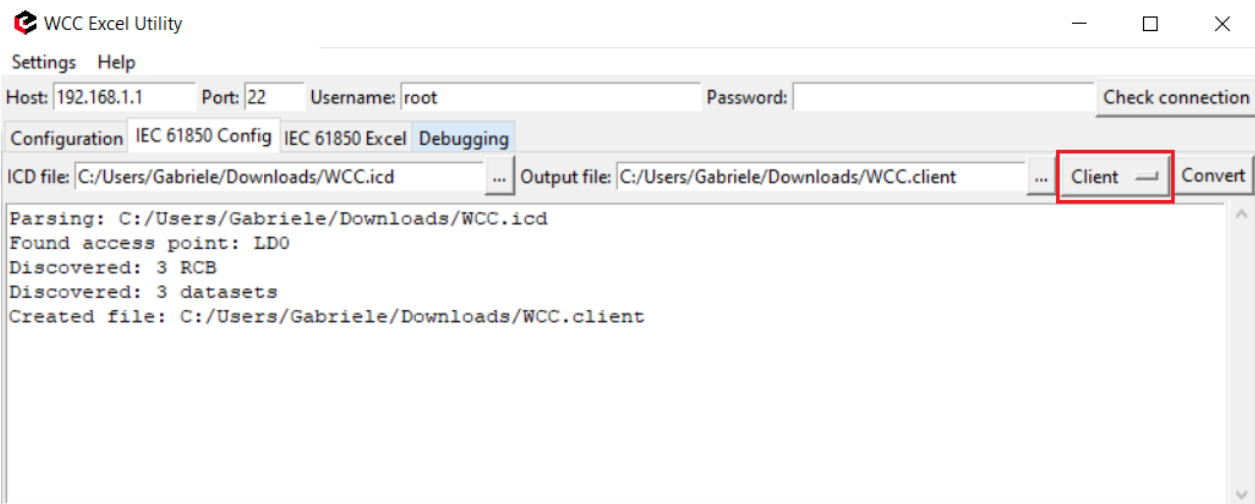

Generate IEC 61850 Client model file.

## Generate Excel file

To generate the IEC 61850 Client Excel file, select "Client" in the drop-down selection tab. Then select where to output the generated model upload file with extensions .icd, .scd or .cid.

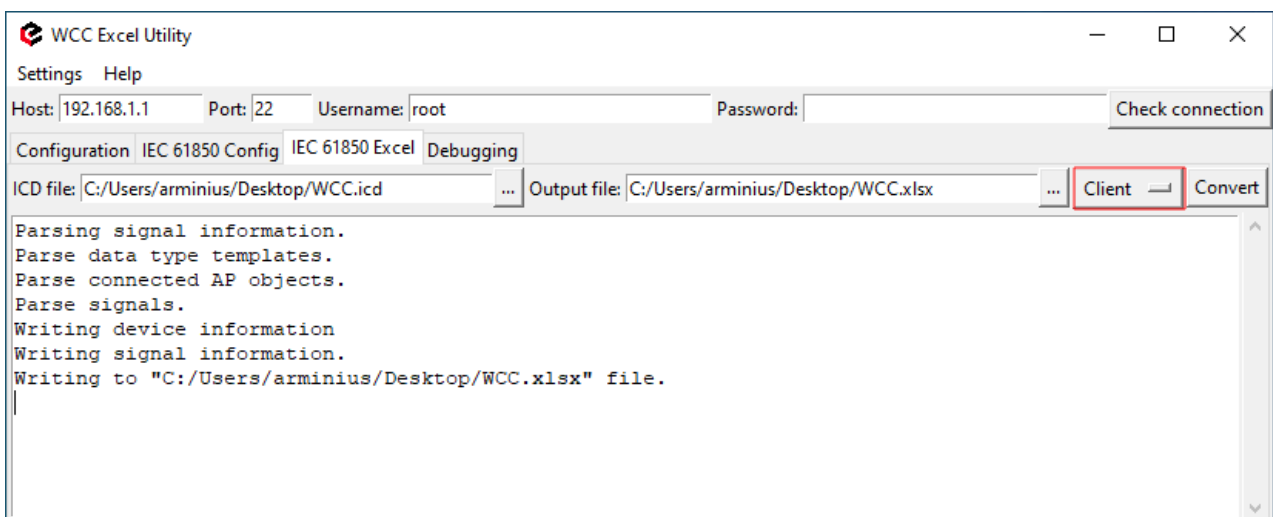

Generate IEC 61850 Client Excel file.

After generating the Excel file, additional configuration information must be written in the devices sheet:

- A valid host ip address must be provided.
- An authorisation method must be provided (if it is a complex authorisation method, additional parameters might be required).
- The model filename must be provided. The model filename must be the same as that generated one step earlier (The model filename can include an extension, but it is not mandatory).

I	J	K
host	authorization	model_filename
192.168.122.146	none	WCC

Excel configuration (Devices sheet)

In the signals sheet, signals which are not used or needed can be removed. Their information might be modified as well.

A	B	C	D	E	F	G	H	I	J	K
device alias	signal name	signal alias	ld_instance	ln_class	ln_instance	ln_prefix	cdc	data_object	data_fc	number_type
iec 61850 client	LD0_GGIO_1_SPS1_stVal	LD0_GGIO_1_SPS1_stVal	LD0	GGIO	1		SPS	SPS1	ST	BOOLEAN
iec 61850 client	LD0_GGIO_1_SPS2_stVal	LD0_GGIO_1_SPS2_stVal	LD0	GGIO	1		SPS	SPS2	ST	BOOLEAN
iec 61850 client	LD0_GGIO_2_SPC1_origin.orCat	LD0_GGIO_2_SPC1_origin.orCat	LD0	GGIO	2		SPC	SPC1	ST	INT8
iec 61850 client	LD0_GGIO_2_SPC1_origin.ordident	LD0_GGIO_2_SPC1_origin.ordident	LD0	GGIO	2		SPC	SPC1	ST	OCTET STRING 6
iec 61850 client	LD0_GGIO_2_SPC1_ctiNum	LD0_GGIO_2_SPC1_ctiNum	LD0	GGIO	2		SPC	SPC1	ST	INT8U
iec 61850 client	LD0_GGIO_2_SPC1_stSeld	LD0_GGIO_2_SPC1_stSeld	LD0	GGIO	2		SPC	SPC1	ST	BOOLEAN
iec 61850 client	LD0_GGIO_2_SPC1_stVal	LD0_GGIO_2_SPC1_stVal	LD0	GGIO	2		SPC	SPC1	ST	BOOLEAN
iec 61850 client	LD0_GGIO_2_SPC1_Oper.ctiVal	LD0_GGIO_2_SPC1_Oper.ctiVal	LD0	GGIO	2		SPC	SPC1	CO	BOOLEAN
iec 61850 client	LD0_GGIO_2_SPC2_origin.orCat	LD0_GGIO_2_SPC2_origin.orCat	LD0	GGIO	2		SPC	SPC2	ST	INT8
iec 61850 client	LD0_GGIO_2_SPC2_origin.ordident	LD0_GGIO_2_SPC2_origin.ordident	LD0	GGIO	2		SPC	SPC2	ST	OCTET STRING 6
iec 61850 client	LD0_GGIO_2_SPC2_ctiNum	LD0_GGIO_2_SPC2_ctiNum	LD0	GGIO	2		SPC	SPC2	ST	INT8U
iec 61850 client	LD0_GGIO_2_SPC2_stSeld	LD0_GGIO_2_SPC2_stSeld	LD0	GGIO	2		SPC	SPC2	ST	BOOLEAN
iec 61850 client	LD0_GGIO_2_SPC2_stVal	LD0_GGIO_2_SPC2_stVal	LD0	GGIO	2		SPC	SPC2	ST	BOOLEAN
iec 61850 client	LD0_GGIO_2_SPC2_Oper.ctiVal	LD0_GGIO_2_SPC2_Oper.ctiVal	LD0	GGIO	2		SPC	SPC2	CO	BOOLEAN
iec 61850 client	LD0_GGIO_3_DPS1_stVal	LD0_GGIO_3_DPS1_stVal	LD0	GGIO	3		DPS	DPS1	ST	CODEENUM
iec 61850 client	LD0_GGIO_3_DPS2_stVal	LD0_GGIO_3_DPS2_stVal	LD0	GGIO	3		DPS	DPS2	ST	CODEENUM
iec 61850 client	LD0_GGIO_4_DPC1_origin.orCat	LD0_GGIO_4_DPC1_origin.orCat	LD0	GGIO	4		DPC	DPC1	ST	INT8
iec 61850 client	LD0_GGIO_4_DPC1_origin.ordident	LD0_GGIO_4_DPC1_origin.ordident	LD0	GGIO	4		DPC	DPC1	ST	OCTET STRING 6
iec 61850 client	LD0_GGIO_4_DPC1_ctiNum	LD0_GGIO_4_DPC1_ctiNum	LD0	GGIO	4		DPC	DPC1	ST	INT8U
iec 61850 client	LD0_GGIO_4_DPC1_stSeld	LD0_GGIO_4_DPC1_stSeld	LD0	GGIO	4		DPC	DPC1	ST	BOOLEAN
iec 61850 client	LD0_GGIO_4_DPC1_stVal	LD0_GGIO_4_DPC1_stVal	LD0	GGIO	4		DPC	DPC1	ST	CODEENUM
iec 61850 client	LD0_GGIO_4_DPC1_Oper.ctiVal	LD0_GGIO_4_DPC1_Oper.ctiVal	LD0	GGIO	4		DPC	DPC1	CO	BOOLEAN
iec 61850 client	LD0_GGIO_4_DPC2_origin.orCat	LD0_GGIO_4_DPC2_origin.orCat	LD0	GGIO	4		DPC	DPC2	ST	INT8
iec 61850 client	LD0_GGIO_4_DPC2_origin.ordident	LD0_GGIO_4_DPC2_origin.ordident	LD0	GGIO	4		DPC	DPC2	ST	OCTET STRING 6
iec 61850 client	LD0_GGIO_4_DPC2_ctiNum	LD0_GGIO_4_DPC2_ctiNum	LD0	GGIO	4		DPC	DPC2	ST	INT8U
iec 61850 client	LD0_GGIO_4_DPC2_stSeld	LD0_GGIO_4_DPC2_stSeld	LD0	GGIO	4		DPC	DPC2	ST	BOOLEAN
iec 61850 client	LD0_GGIO_4_DPC2_stVal	LD0_GGIO_4_DPC2_stVal	LD0	GGIO	4		DPC	DPC2	ST	CODEENUM
iec 61850 client	LD0_GGIO_4_DPC2_Oper.ctiVal	LD0_GGIO_4_DPC2_Oper.ctiVal	LD0	GGIO	4		DPC	DPC2	CO	BOOLEAN
iec 61850 client	LD0_GGIO_5_AnIn1_mag.f	LD0_GGIO_5_AnIn1_mag.f	LD0	GGIO	5		MV	AnIn1	MX	FLOAT32
iec 61850 client	LD0_GGIO_5_AnIn2_mag.f	LD0_GGIO_5_AnIn2_mag.f	LD0	GGIO	5		MV	AnIn2	MX	FLOAT32

Signals sheet

**Important!** Information such as ld\_instance and other data taken directly from SCD configuration files should not be modified, otherwise, access to the information of these reports can be broken.

## Uploading configuration

First, upload the model configuration file.

CONFIGURATION

IMPORTED SIGNALS

EVENT LOG

PROTOCOL CONNECTIONS

SCRIPT-RUNNER

### Protocol configuration

**IMPORT PROTOCOL CONFIGURATION**

Here you can import Excel configuration file. Up to 1000 signals are allowed. All previous signals will be replaced.

Configuration file:

Choose File No file chosen

Import configuration

PLC (IEC-61499) Boot file:

Choose File No file chosen

Import FBOOT file

IEC61850 Client model file:

Choose File WCC.client

Import client model file

IEC61850 Server model file:

Choose File No file chosen

Import server model file

**DOWNLOAD CONFIGURATION**

Template configurations:

Download

Uploading the model configuration file

After uploading the model configuration file, it should appear under the *DOWNLOAD CONFIGURATION* tab.

**DOWNLOAD CONFIGURATION**

Template configurations:
 

Download

Current IEC 61850 client model file (WCC.client):
 

Download

Delete

Uploaded IEC 6180 Client configuration file

Then upload the Excel configuration (same as with every other protocol).

PROTOCOL HUB

CONFIGURATION

STATUS

SYSTEM

SERVICES

NETWORK

USERS

LOGOUT (ROOT)

IMPORTED SIGNALS

EVENT LOG

PROTOCOL CONNECTIONS

**IMPORT PROTOCOL CONFIGURATION**

Configuration file:

Choose File

WCC.xlsx

Import configuration

PLC (IEC-61499) Boot file:

Choose File

No file chosen

Import FBOOT file

IEC61850 Client model file:

Choose File

No file chosen

Import client model file

IEC61850 Server model file:

Choose File

No file chosen

Import server model file

Uploading Excel configuration

After successful configuration upload, both configurations should appear under the *DOWNLOAD CONFIGURATION* tab. If any errors occur during Excel upload, fix them according to the Excel utility guidelines.

**DOWNLOAD CONFIGURATION**

Current configuration (WCC.xlsx):
 

Download

Template configurations:
 

Download

Current IEC 61850 client model file (WCC.json):
 

Download

Delete

Uploaded configurations

## IEC 61850 Client command line debugging options

- Step 1:** Service must be stopped by entering the following command into the wcccli:

```
/etc/init.d/iec61850-client stop
```

- Step 2:** After the service is stopped, it must be started with the preferred configuration file (JSON files found in the /etc/ folder) and a debug level 7:

```
iec61850-client -c /etc/iec61850-client/iec61850-client.json -d7
```

Additional output forming options described in the table below.


- Step 3:** Once the problem is diagnosed, normal operations can be resumed with the following command:

```
/etc/init.d/iec61850-client start
```

```
-h [ -help ] Show help message
-c [ -config ] arg Configuration file location
-V [ -version ] Show version
```

```
-d [--debug] arg Set debugging level  
-r [--redis] Show Redis messages
```

⚠ If the IEC 61850 Client does not work properly (e.g. no communication between devices, data is corrupted, etc.), a user can launch a debug session from the command line interface and find out why the link is not functioning properly.

 To launch a debugging session, a user should stop `iec61850-client` process by running `/etc/init.d/iec61850-client stop` and run `iec61850-client` command with respective flags as was shown above.